




DEWETRON

PA-IT-700U CURRENT TRANSDUCER

FOR ULTRA-HIGH PRECISION MEASUREMENT OF CURRENT: DC, AC, PULSED...,
WITH GALVANIC SEPARATION BETWEEN
PRIMARY AND SECONDARY

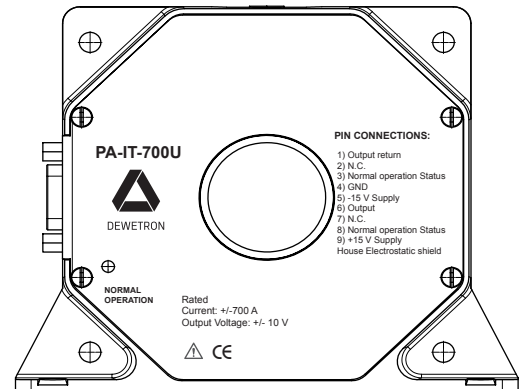

$$I_{PM} = 700 \text{ A}$$

FEATURES

- > $\pm 10 \text{ V}$ voltage output
- > Closed loop (compensated) current transducer using an extremely accurate zero flux detector
- > Electrostatic shield between primary and secondary circuit
- > 9-pin D-Sub male secondary connector
- > Status signal to indicate the transducer state
- > LED indicator confirms normal operation.

ADVANTAGES

- > Very high accuracy
- > Excellent linearity
- > Extremely low temperature drift
- > Wide frequency bandwidth
- > High immunity to external fields
- > No insertion losses
- > Low noise on output signal
- > Low noise feedback to primary conductor.

APPLICATION DOMAINS

- > Industrial
- > Laboratory
- > Medical

APPLICATIONS

- > Feedback element in high performance gradient amplifiers for MRI
- > Feedback element in high-precision, high-stability power supplies
- > Calibration unit
- > Energy measurement
- > Medical equipment.

STANDARDS

- > EN 61000-6-2: 2005
- > EN 61000-6-3: 2007
- > EN 61010-1: 2010



DEWETRON

INSULATION COORDINATION

PARAMETER	SYMBOL	UNIT	VALUE	COMMENT
Rated insulation rms voltage, basic insulation	U_b	V	1600	IEC 61010-1 conditions - over voltage cat III - pollution degree 2
Rated insulation rms voltage, reinforced insulation	U_b	V	300	IEC 61010-1 conditions - over voltage cat III - pollution degree 2
Rated insulation rms voltage, basic insulation	U_b	V	1000	EN 50178 conditions - over voltage cat III - pollution degree 2
Rated insulation rms voltage, reinforced insulation	U_b	V	600	EN 50178 conditions - over voltage cat III - pollution degree 2
Rms voltage for AC insulation test, 50/60 Hz, 1 min	U_d	kV	4.6	Between primary and secondary + shield
		VDC	200	Between secondary and shield
		VDC	500	Between secondary and status output
Impulse withstand voltage 1.2/50 μ s	$\hat{U}_w$	kV	8.5	
Clearance (pri. - sec.)	d_{cl}	mm	9	Shortest distance through air
Creepage distance (pri. - sec.)	d_{cp}	mm	9	Shortest path along device body
Comparative tracking index	CTI	V	600	

If insulated cable is used for the primary circuit, the voltage category could be improved with the following table (for single insulation) (IEC 61010-1 standard):

Cable insulated (primary)	Category
HAR03	1750 V CAT III
HAR05	1850 V CAT III
HAR07	1950 V CAT III

ENVIRONMENTAL AND MECHANICAL CHARACTERISTICS

PARAMETER	SYMBOL	UNIT	MIN	TYP	MAX	COMMENT
Ambient operating temperature	T_A	°C	10		50	
Ambient storage temperature	T_S	°C	-20		85	
Relative humidity	RH	%	20		80	Non-condensing
Dimensions						See drawing page 7
Mass	m	kg		0.8		



DEWETRON

ELECTRICAL DATA

At $T_A = 25\text{ °C}$, $\pm U_C = \pm 15\text{ V}$, unless otherwise noted.

PARAMETER	SYMBOL	UNIT	MIN	TYP	MAX	COMMENT
Primary continuous direct current	I_{PNDC}	A	-700		700	
Primary nominal rms current	I_{PN}	A			495	
Primary current, measuring range	I_{PM}	A	-700		700	
Resistance of secondary winding	R_S	Ω		20		
Overload capability ¹⁾	$\hat{I}_P$	kA	-3.5		3.5	@ pulse of 100 ms
Supply voltage	U_C	V	± 14.25	± 15	± 15.75	
Current consumption	I_C	mA			80 480	$I_P = 0$ @ I_{PN}
Output rms noise 0 .. 10 Hz ²⁾	V_{NO}	ppm			1	
Output rms noise 0 .. 100 Hz ²⁾					2	
Output rms noise 0 .. 1 kHz ²⁾					2	
Output rms noise 0 .. 10 kHz ²⁾					5	
Output rms noise 0 .. 50 kHz ²⁾					10	
Secondary voltage	V_S	V	-10		10	
Sensitivity	G	V/A		1/70		
Sensitivity error ²⁾	ε_G	ppm	-50		50	
Temperature coefficient of G ²⁾	TCG	ppm/K	-3		3	10 °C .. 50 °C
Re-injected rms noise on primary bus bar		μV			30	0 .. 50 kHz
Electrical offset voltage + self magnetization + effect of earth magnetic field ²⁾	I_{OE}	ppm			60	
Temperature coefficient of V_{OE} ²⁾	TCI _{OE}	ppm/K			4	10 °C .. 50 °C
Offset stability ²⁾		ppm/month			1	
Linearity error ²⁾	ε_L	ppm			30	
Step response time to 90 % of I_{PNDC}	t_r	μs			1	di/dt of 25 A/ μs
di/dt accurately followed	di/dt	A/ μs	100			
Frequency bandwidth ($\pm 1\text{ dB}$)	BW	kHz	0	50		Small-signal bandwidth, 0.5% of I_{PM}
Frequency bandwidth ($\pm 3\text{ dB}$)	BW	kHz	0	100		Small-signal bandwidth, 0.5% of I_{PM}

Notes: ¹⁾ Single pulse only, not AC. The transducer may require a few seconds to return to normal operation when autoreset system is running.

²⁾ All ppm figures refer to nominal current I_{PNDC} .



DEWETRON

OVERLOAD PROTECTION - ELECTRICAL SPECIFICATION - STATUS

The overload occurs when the primary current I_p exceeds a trip level such that the fluxgate detector becomes completely saturated and, consequently, the transducer will switch from normal operation to overload mode.

This trip level is guaranteed to be greater than 110 % of I_{PNDC} and its actual value depends on operating conditions such as temperature and measuring resistance.

When this happens, the transducer will automatically begin to sweep in order to lock on the primary current again and the secondary current generated is a low frequency triangle waveform between -10 V and +10 V.

Under these conditions:


- > The contact (normal operation status) between pin 3 and 8 (of the D-sub connector) switches off, this contact becomes open.
- > The green LED indicator (normal operation status) turns off.

The measuring can resume when the primary current returns in the nominal range between $-I_{PNDC}$ and $+I_{PNDC}$ then the green LED indicator (normal operation status) is again lit.

ELECTRICAL DATA - STATUS PORT


Max voltage pin 3 and pin 8, off-State	100 V
Max current pin 3 and pin 8, on-State	1000 mA
On-State resistance pin 3 and pin 8:	50 m Ω (typ)

STATUS/INTERLOCK PORT WIRING

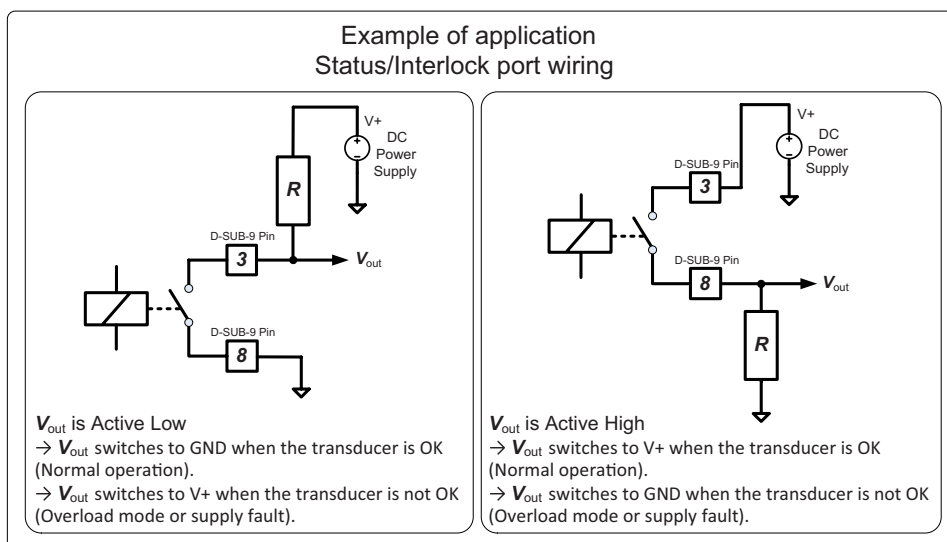

PERFORMANCE PARAMETERS DEFINITION

The schematic used to measure all electrical parameters is shown below:

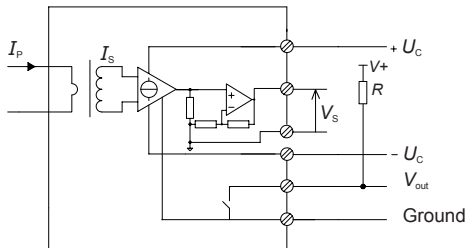

TRANSDUCER SIMPLIFIED MODEL

The static model of the transducer at temperature T_A is:

$$V_s = G \cdot I_p + \text{error}$$

In which

$$\text{error} = V_{OE} \text{ at } 25^\circ\text{C} + V_{OT}(T_A) + \epsilon_L \cdot I_{PM} \cdot G$$

Where,

$$V_{OT}(T_A) = TC V_{OE} \cdot |T_A - 25^\circ\text{C}| \cdot I_{PM} \cdot G$$

V_s :	secondary voltage (V)
G :	sensitivity (V/A)
I_p :	primary current (A)
I_{PM} :	primary current, measuring range (A)
T_A :	ambient operating temperature ($^\circ\text{C}$)
V_{OE} :	electrical offset voltage (V)
V_{OT} :	temperature variation of VOE at T_A (V)
ϵ	ϵ_L : linearity error

This is the absolute maximum error. As all errors are independent, a more realistic way to calculate the error would be to use the following formula:

$$\text{error} = \sqrt{\sum (\text{error_component})^2}$$

LINEARITY

To measure linearity, the primary current (DC) is cycled from 0 to I_{PM} , then to $-I_{PM}$ and back to 0 (equally spaced $I_{PM}/10$ steps). The linearity error ϵ_L is the maximum positive or negative difference between the measured points and the linear regression line, expressed in parts per million (ppm) of fullscale which corresponds to the maximum measured value.

ELECTRICAL OFFSET


The electrical offset voltage V_{OE} is the residual output voltage when the input current is zero.

The temperature variation V_{OT} of the electrical offset voltage V_{OE} is the variation of the electrical offset from 25°C to the considered temperature.

RESPONSE TIME

The response time t_r is shown in the next figure.

It depends on the primary current di/dt and it's measured at nominal current.

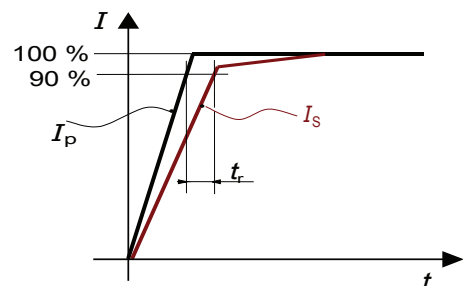



DEWETRON

SAFETY

This transducer must be used in limited-energy secondary circuits according to IEC 61010-1.



This transducer must be used in electric/electronic equipment with respect to applicable standards and safety requirements in accordance with the manufacturer's operating instructions.



Caution, risk of electrical shock

When operating the transducer, certain parts of the module can carry hazardous voltage (eg. primary busbar, power supply).


Ignoring this warning can lead to injury and/or cause serious damage.

This transducer is a build-in device, whose conducting parts must be inaccessible after installation.

A protective housing or additional shield could be used.

Main supply must be able to be disconnected.

DIMENSIONS

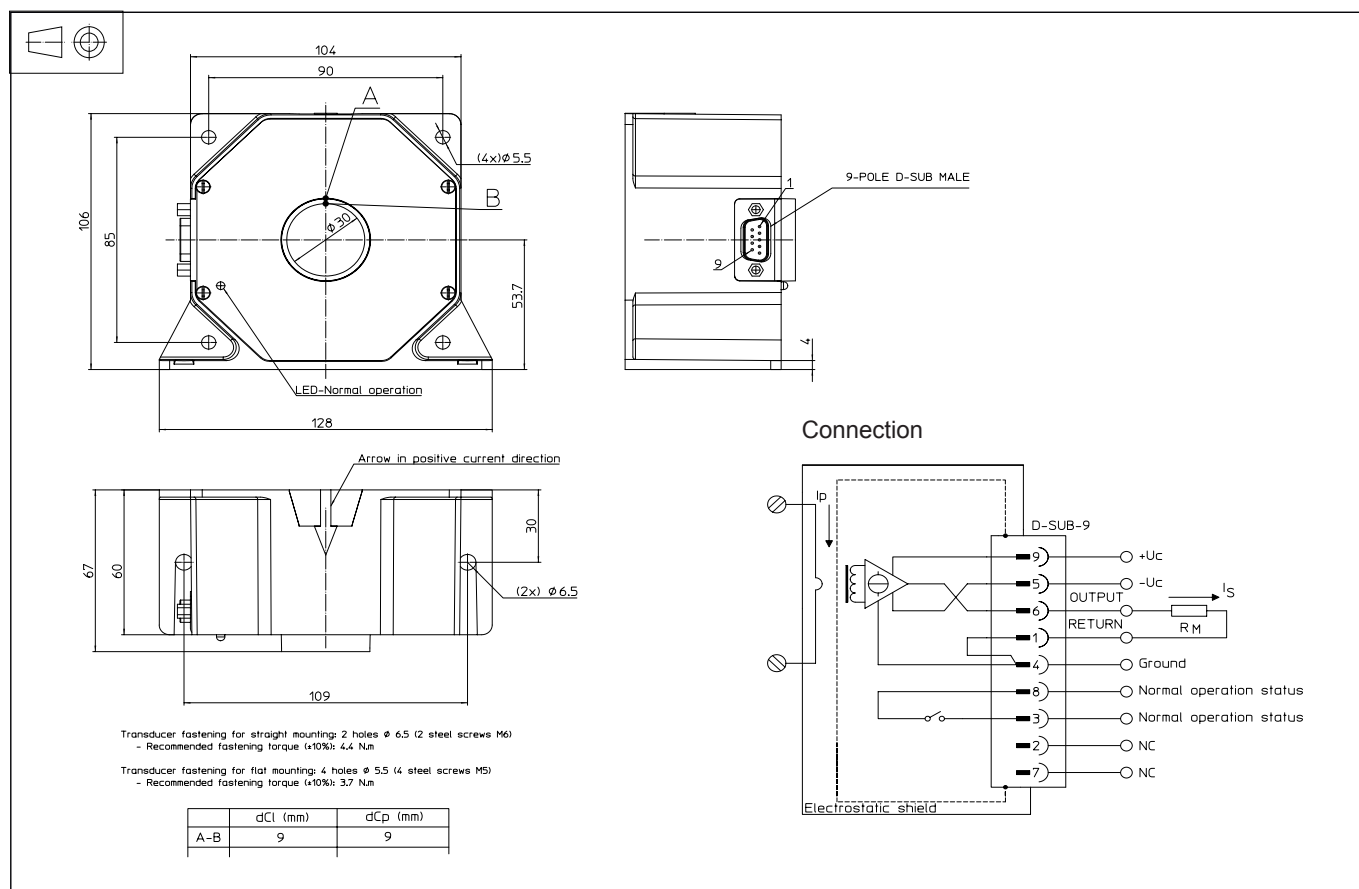

CONNECTION

- > Normal operation status (Pins 3 and 8)
- Normal operation means:
 - $\pm 15 \text{ V}$ ($\pm U_c$) present
 - zero detector is working
 - compensation current $\leq 110\%$ of I_{PNDC}
 - green LED indicator is lit.

CONTACT (PINS 3 & 8)	DESCRIPTION
Closed	The transducer is OK (Normal operation)
Open	The transducer is not OK (Overload mode or supply fault)

REMARKS

- > I_s is positive when I_p flows in the direction of the arrow.
- > We recommend that a shielded output cable and plug are used to ensure the maximum immunity against electrostatic fields.
- > Pin 4 should be connected to cable and connector shield to maintain lowest output noise.
- > Temperature of the primary conductor should not exceed 50°C .

MECHANICAL CHARACTERISTICS

- > General tolerance $\pm 0.3 \text{ mm}$
- > Transducer fastening
 - Straight mounting: 2 holes $\varnothing 6.5 \text{ mm}$, 2 x M6 steel screws, Recommended fastening torque 4.4 Nm
 - Flat mounting: 4 holes $\varnothing 5.5 \text{ mm}$, 4 x M5 steel screws, Recommended fastening torque 3.7 Nm
- > Connection of secondary connector on D-SUB-9, UNC 4-40
- > All mounting recommendations are given for a standard mounting. Screws with flat and spring washers.
- > Primary through hole $\varnothing \leq 30 \text{ mm}$
- > Installation of the transducer must be done unless otherwise specified on the datasheet, according to LEM Transducer Generic Mounting Rules. Please refer to LEM document N°ANE120504 available on our Web site.